

DETAILED PROJECT REPORT ON COMMON SHAFT DRIVE SYSTEM (1.5 TPH) (GANJAM RICE MILL CLUSTER)



Bureau of Energy Efficiency

Prepared By



Reviewed By



INDIVIDUAL MOTOR DRIVES FOR RICE MILL (1.5 TPH)

GANJAM RICE MILLS CLUSTER

BEE, 2010

Detailed Project Report on Individual Drive System (1.5 TPH)

Rice Mill SME Cluster, Ganjam, Orissa (India)

New Delhi: Bureau of Energy Efficiency;

Detail Project Report No.: **Ganjam/Ricemills/PC/01**

For more information

Bureau of Energy Efficiency (BEE)
(Ministry of Power, Government of India)
4th Floor, Sewa Bhawan
R. K. Puram, New Delhi – 110066

Telephone +91-11-26179699

Fax+91-11-26178352

Websites: www.bee-india.nic.in

Email: jsood@beenet.in/ pktiwari@beenet.in

Acknowledgement

We are sincerely thankful to the Bureau of Energy Efficiency, Ministry of Power, for giving us the opportunity to implement the BEE SME project in “Ganjam Rice Cluster, Ganjam”. We express our sincere gratitude to all concerned officials for their support and guidance during the conduct of this exercise.

Dr. Ajay Mathur, Director General, BEE

Smt. Abha Shukla, Secretary, BEE

Shri Jitendra Sood, Energy Economist, BEE

Shri Pawan Kumar Tiwari, Advisor (SME), BEE

Shri Rajeev Yadav, Project Economist, BEE

Zenith Energy Services Pvt. Ltd. (ZESPL) is also thankful to Shri Purna Chandra Sahu, President, Shri Santhosh Kumar Sahu, Secretary, Ganjam District Rice Mill Owners Association, Berhampur and to Shri Bibudatta Panigrahi, M/s Aanjeneya Modern Rice Mill for their valuable inputs, co-operation, support and identification of the units for energy use and technology audit studies and facilitating the implementation of BEE SME program in Ganjam Rice Cluster.

We take this opportunity to express our appreciation for the excellent support provided by Rice Unit Owners, Local Service Providers, and Equipment Suppliers for their active involvement and their valuable inputs in making the program successful and in completion of the Detailed Project Report (DPR).

ZESPL is also thankful to all the SME owners, plant in charges and all workers of the SME units for their support during the energy use and technology audit studies and in implementation of the project objectives.

Zenith Energy Services Private Ltd.

Hyderabad

Contents

| | |
|-----------------------------------------------------------------------------------|-------------|
| <i>List of Annexure</i> | <i>vii</i> |
| <i>List of Tables</i> | <i>vii</i> |
| <i>List of Figures</i> | <i>viii</i> |
| <i>List of Abbreviation</i> | <i>viii</i> |
| <i>Executive summary</i> | <i>ix</i> |
| <i>About BEE'S SME program</i> | <i>xi</i> |
| 1 INTRODUCTION | 1 |
| 1.1 Brief Introduction about cluster | 1 |
| 1.1.1 Production process | 1 |
| 1.2 Energy performance in existing situation | 4 |
| 1.2.1 Electricity consumption of a typical unit in the cluster..... | 4 |
| 1.2.2 Average production by a typical unit in the cluster | 4 |
| 1.2.3 Specific Energy Consumption | 4 |
| 1.3 Existing technology/equipment | 4 |
| 1.3.1 Description of existing technology..... | 4 |
| 1.3.2 Its role in the whole process | 5 |
| 1.4 Establishing the baseline for the equipment to be changed | 6 |
| 1.4.1 Design and operating parameters power consumption per year | 6 |
| 1.4.2 Electricity consumption | 6 |
| 1.4.2 Operating efficiency of the existing system | 7 |
| 1.5 Barriers for adoption of new and energy efficient technology / equipment..... | 7 |
| 1.5.1 Technological Barriers | 7 |
| 1.5.2 Financial Barrier..... | 7 |
| 1.5.3 Skilled manpower | 7 |
| 1.5.4 Other barrier(s) | 7 |
| 2. EQUIPMENT OPTION FOR ENERGY EFFICIENCY IMPROVEMENT | 8 |

| | | |
|-----------|--------------------------------------------------------------------------------|-----------|
| 2.1 | Detailed description of technology/equipment selected..... | 8 |
| 2.1.1 | Description of technology..... | 8 |
| 2.1.2 | Technology /Equipment specifications | 8 |
| 2.1.3 | Justification of the technology selected & its suitability..... | 9 |
| 2.1.4 | Superiority over existing technology/equipment | 9 |
| 2.1.5 | Availability of the proposed technology/equipment..... | 10 |
| 2.1.6 | Source of technology/equipment for the project..... | 10 |
| 2.1.7 | Service/technology providers | 10 |
| 2.1.8 | Terms of sales of the suppliers, etc..... | 10 |
| 2.1.9 | Process down time during implementation..... | 10 |
| 2.2 | Life cycle assessment and risks analysis | 10 |
| 2.3 | Suitable unit/plant size the identified equipment..... | 10 |
| 3. | ECONOMIC BENEFITS OF NEW ENERGY EFFICIENT TECHNOLOGY | 11 |
| 3.1 | Technical benefits..... | 11 |
| 3.1.1 | Fuel Saving..... | 11 |
| 3.1.2 | Electricity savings | 11 |
| 3.1.2 | Improvement in product quality | 11 |
| 3.1.3 | Increase in production..... | 11 |
| 3.1.4 | Reduction in raw material consumption | 11 |
| 3.1.5 | Reduction in other losses..... | 11 |
| 3.2 | Monetary benefits | 11 |
| 3.3 | Social benefits | 11 |
| 3.3.1 | Improvement in working environment in the plant | 11 |
| 3.3.2 | Improvement in skill set of workers | 12 |
| 3.4 | Environmental benefits | 12 |
| 3.4.1 | Reduction in effluent generation | 12 |
| 3.4.2 | Reduction in GHG emission such as CO ₂ , NO _x , etc..... | 12 |

| | | |
|-----------|-------------------------------------------------------------|-----------|
| 3.4.3 | Reduction in other emissions like SO _x | 12 |
| 4. | INSTALLATION OF NEW ENERGY EFFICIENT EQUIPMENT | 13 |
| 4.1 | Cost of equipment implementation..... | 13 |
| 4.1.1 | Cost of equipments..... | 13 |
| 4.1.2 | Other costs | 13 |
| 4.2 | Arrangement of funds | 13 |
| 4.2.1 | Entrepreneur's contribution | 13 |
| 4.2.2 | Loan amount..... | 13 |
| 4.2.3 | Terms & conditions of loan | 13 |
| 4.3 | Financial indicators | 14 |
| 4.3.1 | Cash flow analysis | 14 |
| 4.3.2 | Simple payback period..... | 14 |
| 4.3.3 | Net Present Value (NPV) | 14 |
| 4.3.4 | Internal rate of return (IRR) | 14 |
| 4.3.5 | Return on investment (ROI) | 14 |
| 4.4 | Sensitivity analysis | 14 |
| 4.5 | Procurement and implementation schedule | 15 |

List of Annexure

| | |
|-------------------------------------------------------------------------|----|
| Annexure 1: Energy audit and baseline establishment | 16 |
| Annexure 2: Process flow diagram | 17 |
| Annexure 3: Detailed Technology Assessment Report | 18 |
| Annexure 4: Detailed Financial Calculations & Analysis | 19 |
| Annexure 5: Details of procurement and Implementation plan..... | 23 |
| Annexure 6: Details of technology/equipment and service providers | 24 |
| Annexure 7: Quotations or Techno-Commercial Bids | 25 |

List of Table

| | |
|-------------------------------------------------------------------------------------|----|
| Table 1.1: Energy consumption of a typical unit (M/s Balaji Traders)..... | 4 |
| Table 1.2: Specific energy consumption for a typical unit (M/s Balaji Traders)..... | 4 |
| Table 1.3 Existing Motor and drives specifications (M/s Balaji Traders Mill) | 5 |
| Table 1.4 Operating parameters of the existing system (M/s Balaji Traders) | 6 |
| Table 1.5 Power consumption of three typical units of common drives system..... | 6 |
| Table 2.1: Proposed Motors Specifications | 8 |
| Table 4.1: Project cost..... | 13 |
| Table 4.2: Sensitivity analysis | 14 |

List of Figures

| | |
|-----------------------------------------------------------------------|---|
| Figure 1: General Process Flowchart of a Typical Rice Mill Unit | 3 |
|-----------------------------------------------------------------------|---|

Lists of Abbreviations

| | |
|----------|--------------------------------------------------|
| ▪ BEE | - Bureau of Energy Efficiency |
| ▪ DPR | - Detailed Project Report |
| ▪ DSCR | - Debt Service Coverage Ratio |
| ▪ GHG | - Green House Gases |
| ▪ HP | - Horse Power |
| ▪ IRR | - Internal Rate of Return |
| ▪ MoP | - Ministry of Power |
| ▪ MSME | - Micro Small and Medium Enterprises |
| ▪ NPV | - Net Present Value |
| ▪ ROI | - Return On Investment |
| ▪ MoMSME | - Ministry of Micro Small and Medium Enterprises |
| ▪ SIDBI | - Small Industrial Development Bank of India |
| ▪ TPH | - Ton Per Hour |

EXECUTIVE SUMMARY

Zenith Energy Services Pvt. Ltd is executing BEE-SME program in Ganjam Rice Mills Cluster, supported by Bureau of Energy Efficiency (BEE) with an overall objective of improving the energy efficiency in cluster units.

Paddy is one of the major crops cultivated in the eastern states especially in the state of Orissa. The Rice comes out of milling of paddy. Hence rice milling is an important activity in the state. There are about 250 rice mills in Ganjam rice mills cluster covering Berhampur, Hinjilicut, Bhanjanagar, and Ganjam areas. The major Energy forms used in the cluster is electricity. Electricity is used for driving the prime movers of elevators, Chaluni, separator, paddy cleaners, Rubber Sheller, and whiteners/cones, drives and for lighting. The cost of energy as a percentage of end product cost (Rice) cost varies anywhere between of 1% to 1.5%.

In about 50 % of the rice mills in the cluster, the rice mill equipments are driven by a single motor common drive system. In these common drive system, all the rice mill machinery like paddy cleaner, rubber sheller, whitener/cone, separator, rice grader and elevators are connected to a single common shaft and driven by a single electric motor. All the equipments are connected by number of long belt drives transmitting mechanical energy to the rice mill equipments. In this type of arrangement huge amount of transmission losses occurred.

Installation of proposed technology i.e. replacement of the common drive system with Individual Drive System consists of individual motors and drives system and is operated independently as and when required. This system reduces transmission losses considerably about 30% of the total power consumption and save upto 15,120 kWh of electricity per year for the unit having 1.5 TPH production capacity.

The DPR highlights the details of the study conducted for assessing the potential for reducing electricity consumption by replacing the present common drives system with new individuals system in various units of the cluster, possible electricity savings and its monetary benefit, availability of the technologies/design, local service providers, technical features and proposed equipment specifications, various barriers in implementation, environmental aspects, estimated GHG reductions, capital cost, financial analysis, and schedule of Project implementation.

This bankable DPR also found eligible for subsidy scheme of MoMSME for “Technology and Quality Upgradation Support to Micro, Small and Medium Enterprises” under “National

Manufacturing and Competitiveness Programme”. The key indicators of the DPR including the Project cost, debt equity ratio, monetary benefit and other necessary parameters are given in table:

| S.No | Particular | Unit | Value |
|------|---------------------------|-------------|-------|
| 1 | Project cost | ` (In lakh) | 1.65 |
| 2 | Electricity saving | kWh/annum | 15120 |
| 3 | Monetary benefit | ` (In lakh) | 0.64 |
| 4 | Debit equity ratio | Ratio | 3:1 |
| 5 | Simple payback period | Years | 2.58 |
| 6 | NPV | ` (In lakh) | 0.65 |
| 7 | IRR | %age | 21.20 |
| 8 | ROI | %age | 24.78 |
| 9 | DSCR | Ratio | 1.53 |
| 10 | Process down time | weeks | 2 |
| 11 | CO ₂ reduction | Ton /year | 15 |

The projected profitability and cash flow statements indicate that the proposed project implementation in the cluster units will be financially viable and technically feasible solution for the cluster.

ABOUT BEE'S SME PROGRAM

Bureau of Energy Efficiency (BEE) is implementing a BEE-SME Programme to improve the energy performance in 29 selected SMEs clusters. Ganjam Rice Mills Cluster is one of them. The BEE's SME Programme intends to enhance the energy efficiency awareness by funding/subsidizing need based studies in SME clusters and giving energy conservation recommendations. For addressing the specific problems of these SMEs and enhancing energy efficiency in the clusters, BEE will be focusing on energy efficiency, energy conservation and technology up-gradation through studies and pilot projects in these SMEs clusters.

Major activities in the BEE -SME program are furnished below:

Activity 1: Energy use and technology audit

The energy use technology studies would provide information on technology status, best operating practices, gaps in skills and knowledge on energy conservation opportunities, energy saving potential and new energy efficient technologies, etc for each of the sub sector in SMEs.

Activity 2: Capacity building of stake holders in cluster on energy efficiency

In most of the cases SME entrepreneurs are dependent on the locally available technologies, service providers for various reasons. To address this issue BEE has also undertaken capacity building of local service providers and entrepreneurs/ Managers of SMEs on energy efficiency improvement in their units as well as clusters. The local service providers will be trained in order to be able to provide the local services in setting up of energy efficiency projects in the clusters

Activity 3: Implementation of energy efficiency measures

To implement the technology up-gradation project in the clusters, BEE has proposed to prepare the technology based detailed project reports (DPRs) for a minimum of five technologies in three capacities for each technology.

Activity 4: Facilitation of innovative financing mechanisms for implementation of energy efficiency projects

The objective of this activity is to facilitate the uptake of energy efficiency measures through innovative financing mechanisms without creating market distortion

1 INTRODUCTION

1.1 Brief Introduction about cluster

Paddy is one of the major crops cultivated in the eastern states especially in the state of Orissa. The Rice comes out of milling of paddy. Hence rice milling is an important activity in the state. There are about 250 rice mills in Ganjam rice mills cluster covering Berhampur, Hinjilicut, Bhanjanagar, and Ganjam areas. The major Energy forms used in the cluster is grid electricity. Electricity is used for driving the prime movers of elevators, Chaluni, separator, paddy cleaners, Rubber Sheller, and whiteners/cones, drives and for lighting. The cost of energy as a percentage of end product cost (Rice) cost varies anywhere between 1% and 1.5%.

1.1.1 Production process

Pre-Cleaner/ Paddy Cleaner

Paddy cleaner is a most essential equipment in a rice mill and separates all the impurities like dust, straw, sand, clay and heavy particles of even and uneven sizes from paddy before the paddy is processed. The clean paddy sent to the rubber roll sheller to process further. The advantages with the paddy cleaner are it increases the life of rubber rollers and the percentage of oil in bran.

The function of the dust blower is to remove the dust from paddy through the pipeline connected to the paddy cleaner. This equipment is recommended for installation in conventional rice mills, also to get the same advantages as of modern rice mills. If this are not removed prior to shelling the efficiency of the rubber Sheller and the milling recovery is reduced.

The pre-cleaners separate three groups of materials:

- The first separation is done by scalping or removing the objects that are larger than the grain. Either a flat oscillating screen or a rotary drum screen that allows the grain to pass through but retains straw.
- The second separation retains the grains but allows broken grains, small stones and weed seeds to pass through. Aspirator is installed to remove the dust and light empty grains

Rubber Sheller

The objective of a hulling/de husking operation is to remove the husk from the paddy grain with a minimum of damage to the bran layer and, if possible, without breaking the brown rice grain. Since, the structure of the paddy grain makes it necessary to apply friction to the grain surface to remove the husk; it leads to breaking of some of the rice.

The paddy is fed into the center of the machine through a small hopper. A vertically adjustable cylindrical sleeve regulates the capacity and equal distribution of the paddy over the entire surface of the rotating disc, paddy is forced between the two discs (rubber Sheller)and as a result of pressure and friction most of the paddy is de husked (hulled), where husk and brown rice are separated.

Separator

The output from the huller is a mixture of brown rice, husk, broken paddy etc. The huller aspirator removes the lighter material such as husk, bran and very small broken rice. The remainder passes onto the paddy separator where the unshelled paddy rice is separated from the brown rice. The amount of paddy present depends on the efficiency of the husker, and normally less than 10%. Paddy separators work by making use of the differences in specific gravity, buoyancy, and size between paddy and brown rice. Paddy rice has a lower specific gravity, higher buoyancy, and is physically bigger, longer and wider than brown rice

The compartment type of paddy separator uses the difference in specific gravity and the buoyancy to separate paddy and brown rice. When paddy and brown rice move over an inclined plane, they move at different speeds depending on their specific gravity, their shape and contact area, smoothness of inclined surface and the co-efficient of sliding friction. Brown grains are smaller, heavier, rounder, and smoother and will slide faster than paddy grains. The processing capacity of the compartment separator is dependent on the compartment area. For a 1.5 ton/hr capacity rice mill, a 45-compartment separator made up of 15 compartments on each of three decks is used.

Whitening and Polishing

In the process of whitening, the skin and bran layer of the brown rice are removed. During polishing of the whitened rice, the bran particles still sticking to the surface of the rice are removed and the surface of the rice is slightly polished to give it a glazed appearance. For further whitening if required as per the market demand or for export market, the polished rice is further processed in the silky machine for additional polishing.

Rice grader

After polishing, the white rice is separated into head rice and, large and small broken rice by a sifter. Head rice is normally classified as kernels, which are 75-80% or more of a whole kernel. The sifter is made up of a series of oscillating or cylindrical screens through which the rice passes. The output from the bottom screen is the very fine broken tips and is called the “brewers”.

Elevators

The elevator used at different stages of rice milling for transferring paddy, brown rice and white rice during the milling process

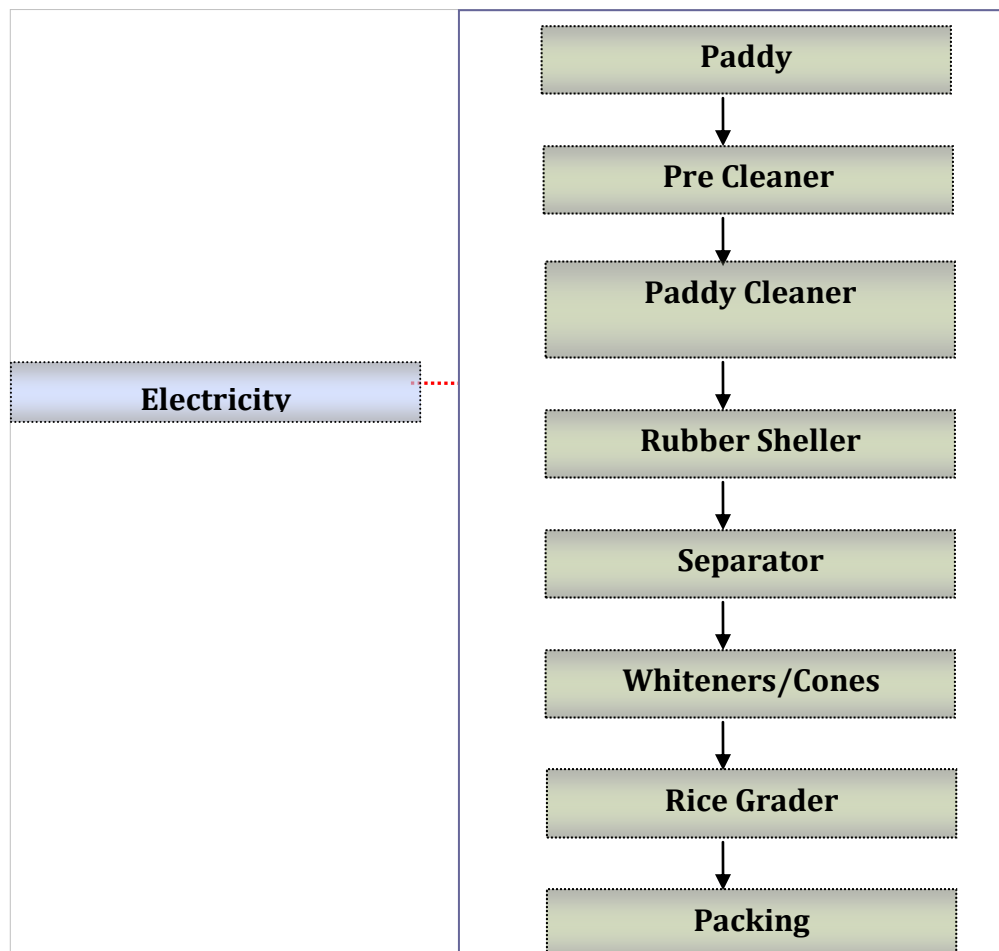


Figure 1.1: General Process Flowchart of a rice mill is furnished below.

1.2 Energy performance in existing situation

1.2.1 Electricity consumption of a typical unit in the cluster

The main source of energy for a typical rice milling unit in the cluster is electricity and is used for driving the prime movers of common drive shaft motor and in individual drive system like elevators, Chaluni, separator, paddy cleaners, Rubber Sheller, and whiteners/cones, drives and for lighting. The energy consumption of a typical rice production unit in the cluster having old and inefficient design common drives system of 1.5 TPH capacities is furnished in Table 1.1 below:

Table 1.1: Energy consumption of a typical unit (M/s Balaji Traders)

| S.No. | Details | Unit | Value |
|-------|-------------------------|-------------|-------|
| 1 | Electricity Consumption | MWh/annum | 50 |
| 2 | Production (Rice) | tonne/annum | 3600 |

1.2.2 Average production by a typical unit in the cluster

The average production in a year in a typical rice production unit is 3600 tonne per annum.

1.2.3 Specific Energy Consumption

The major source of energy for paddy processing is electricity and the specific electricity consumption per ton of processing for a typical unit of having 1.5 TPH capacity is furnished in Table 1.2 below:

Table 1.2: Specific energy consumption for a typical unit (M/s Balaji Traders)

| S. No. | Type of energy | Units | Specific Energy Consumption |
|--------|----------------|---------|-----------------------------|
| 1 | Electricity | kWh/ton | 13.88 |

1.3 Existing technology/equipment

1.3.1 Description of existing technology

In about 50 % of the rice mills in the cluster, the rice mill equipments are driven by a single motor common drive system. In these common drive system, all the rice mill machinery like paddy cleaner, rubber sheller, whiteners/cone, separator, rice grader and elevators are connected to a single common shaft and driven by a single electric motor. All the

equipments are connected by number of long belt drives transmitting mechanical energy to the rice mill equipments. The present single drive system has the following disadvantages w.r.t power consumption.

- High transmission losses due to longer belt drive systems.
- Low efficiency of the motor during under loading, when one or two equipments are operated
- Possibility of operation of motor for idle running for longer periods.
- More chances of production loss due to single motor drive system
- Low power factor due to partial load operation.
- Even for small equipment operation like elevator or paddy cleaner need to be operated higher capacity motor hence more losses.

The existing motor technical specifications of the main motor and operating parameters are furnished in Table 1.3 below:

Table 1.3 Existing Motor and drives specifications (M/s Balaji Traders Mill)

| S.No | Details | Main motor |
|------|--------------------------|--------------------|
| 1 | Rated HP | 50 |
| 2 | Voltage | 398 |
| 3 | Rated Amps | 31.4 |
| 4 | frequency | 50 Hz |
| 5 | Rated (kW) | 37.3 |
| 6 | Transmission system type | Common shaft drive |
| 7 | RPM | 1440 |

1.3.2 Its role in the whole process

The common shaft drive system is driven by a single motor. The common shaft is connected to all the rice mill machinery equipments like Chaluni, separator, paddy cleaners, Rubber Sheller, and whiteners/cones by long flat belt drives and the mechanical energy is transmitted from the main drive to the individual drive systems.

1.4 Establishing the baseline for the equipment to be changed

1.4.1 Design and operating parameters power consumption per year

The present power consumption of a common drive motor is 11.40 kW. The motor is operated for 14 hours in a day for 320 days. The average annual power consumption of the common drive motor is 50000 kWh. The operating parameters of the existing system are furnished in Table 1.4 below:

Table 1.4 Operating parameters of the existing system (M/s Balaji Traders)

| S.No | Details | Main motor |
|------|-------------------------------|--------------|
| 1 | Measured Voltage | 303 |
| 2 | Measured Amps | 24.34 |
| 3 | Power factor | 0.89 |
| 4 | Frequency | 50 Hz |
| 5 | Actual Power Consumption (kW) | 11.40 |
| 6 | Transmission system | v belt drive |
| 7 | RPM | 1440 |
| 8 | Percentage loading | 30.56% |
| 9 | Paddy processing | 1.5 TPH |

1.4.2 Electricity consumption

The electricity consumption of three typical units having 1.5 TPH paddy processing capacity of the existing common drives system is furnished below in Table 1.5 below:

Table 1.5 Power consumption of three typical units of common drives system

| Name of the unit | Average production TPH | Production capacity (Tons /annum) | Average Power consumption (kWh/annum) | Specific energy consumption (kWh/ton) |
|-------------------------|------------------------|-----------------------------------|---------------------------------------|---------------------------------------|
| Balaji Traders | 1.5 | 3600 | 50,000 | 13.88 |
| Devi rive mill | 1.5 | 2,630 | 31,037 | 11.8 |
| Gouri Shankar rice mill | 1.5 | 3159 | 32,857 | 10.4 |

1.4.2 Operating efficiency of the existing system

The detailed energy audits studies had been undertaken in various units of the cluster to evaluate the losses of the common drive system. Based on the studies undertaken, the common drive system consumes about 30% more power than individual drives system due to poor transmission, idle operation and part load operation etc.

1.5 Barriers for adoption of new and energy efficient technology / equipment

1.5.1 Technological Barriers

The major technical barriers that prevented the implementation of the new individual drives system in the cluster are:

- Lack of awareness of the technologies in the area
- Lack of technical knowledge and its losses about the existing system

1.5.2 Financial Barrier

The replacement of common drive system with individual drive system requires high initial investment for the motors and drives. Hence, many of the owners don't show interest for implementation. Further, the production capacity of these mills is low and operated for one shift only for six months.

Further, the lack of awareness of the losses of common drive system and monetary benefit of the new individual drive system is also one of the major factors for implementing the technology.

Energy Efficiency Financing Schemes such as SIDBI's, if focused on the cluster, will play a catalytic role in implementation of identified energy conservation projects & technologies. The cluster has significant potential for implementing the individual drive systems by replacing common drive system.

1.5.3 Skilled manpower

Not applicable

1.5.4 Other barrier(s)

Information on the energy efficient technologies is not available among cluster unit owners.

2. EQUIPMENT OPTION FOR ENERGY EFFICIENCY IMPROVEMENT

2.1 Detailed description of technology/equipment selected

2.1.1 Description of technology

The project activity is replacement of the common drive system with individual drive system. The individual drive system consists of individual motors and drives system and is operated independently as and when required. The motors are connected to the rice mill machinery like elevators, paddy cleaner; rubber sheller, whiteners/cones, separator, grader etc and the capacity of the motors are connected based on the requirement. This system reduces transmission losses considerably about 30% of the total power consumption of the common drive motor system. Apart from reduction in high transmission losses, the power consumption is also reduced due to avoidance of part load operation and idle operation of the equipments. In common drive system, even for operation of a small equipment like elevator, which requires 1 HP in normal scenario, in common drive system, the 50 HP motor is required to be operated and hence more power consumption



2.1.2 Technology /Equipment specifications

The detailed specifications of the motors suggested are furnished in table 2.1 below:

Table 2.1: Proposed Motors Specifications

| S. No. | Parameter | Motor |
|--------|------------------|----------------------|
| 1 | Elevators 6 no's | 1 HP for 3 elevators |
| 2 | Chaluni 2 no's | 1 HP each |
| 3 | Rubber Sheller | 7.5 HP |
| 4 | Cones 2 no's | 10 HP each |
| 5 | Separator 1 no's | 2 HP |

All motors are of TEFC motors and 4 pole motors of reputed company make and necessary shafts, V belts and starters/panel and cabling

2.1.3 Justification of the technology selected & its suitability

As discussed above, the common drive system has high transmission losses due to long belt drives leading to high power consumption. . In these common drive system, all the rice mill machinery like paddy cleaner, rubber sheller, whitener/cone, separator, rice grader and elevators are connected to a single common shaft driven by a single electric motor. All the equipments are connected by a long belt drives transmitting mechanical energy to the rice mill equipments. The present single drive system has the following disadvantages w.r.t. power consumption:

- High transmission losses due to longer belt drive systems.
- Low efficiency of the motor during under loading, when one or two equipments are operated
- Possibility of operation of motor for idle running for longer periods.
- More chances of production loss due to single motor drive system
- Low power factor due to partial load operation.
- Even for small equipment operation like elevator or paddy cleaner need to be operated higher capacity motor hence more losses.

Based on above facts, the common drive system can be replaced with individual motor drive system is a viable option and reducing power consumption. The capacity of the motors selected as per the requirement and suitability.

2.1.4 Superiority over existing technology/equipment

The following are the superior features of individual drive system

- The new system will reduce power consumption considerably by over 30%
- Improved power factor of the electrical system
- The equipments are operated can be operated as required with reduced power consumption
- Improved production as the production down time is reduced due to avoidance of slippages.
- Reduces GHG emissions

2.1.5 Availability of the proposed technology/equipment

The individual drive system and motor suppliers are available at Bhubaneswar and Visakhapatnam which are nearer towns to the cluster. The details of the suppliers are provided in Annexure 6.

2.1.6 Source of technology/equipment for the project

The source of the technology is indigenous and is locally available.

2.1.7 Service/technology providers

Details of service providers had been furnished in Annexure 6.

2.1.8 Terms of sales of the suppliers, etc.

The terms and conditions of the equipment supplier for supply of motors and individual drive systems are furnished below:

Terms & Conditions:

- 40% advance and 40% after delivery of the materials and 20% after completion of the Work
- 12 months guarantee from the date of delivery of the materials

2.1.9 Process down time during implementation

The process down time for installation individual drive system is considered at two weeks for dismantling the existing system and installation of new motors and drives, providing electrical connections to the motor, cable laying, panels and starters installation etc.

2.2 Life cycle assessment and risks analysis

The life of the individual drive system is considered at 20 years. There is no risk involved as the individual drive systems are successfully in operation in since 3 decades in the rice mills.

2.3 Suitable unit/plant size the identified equipment

The motors and drive systems, cables and starters are selected based on the requirement of the existing machinery like paddy cleaner, rubber sheller, elevators, cones etc and also as recommended by the rice mill equipment supplier. Proposed system is suitable for the unit having production 1.5 TPH.

3. ECONOMIC BENEFITS OF NEW ENERGY EFFICIENT TECHNOLOGY

3.1 Technical benefits

3.1.1 Fuel Saving

No fuel saving is envisaged due to proposed technology.

3.1.2 Electricity savings

Installation of individual motor for each machine would reduce the transmission loss up to 30%. Apart from reduction in high transmission losses, the power consumption is also reduced due to avoidance of part load operation and idle operation of the equipments. The power savings due to installation of project activity is estimated at 15,120 kWh per annum. Details of electricity saving is given in Annexure 3.

3.1.2 Improvement in product quality

The product quality will improve to certain extent

3.1.3 Increase in production

The new individual drive system will reduce the frequent breakdowns due to long belts; hence there may be increase in the production for the same duration operation of the rice mill.

3.1.4 Reduction in raw material consumption

Not Applicable.

3.1.5 Reduction in other losses

Not applicable.

3.2 Monetary benefits

The monetary benefit due to installation of individual drive system is estimated at ` 0.64 lakh per annum due to reduction in electricity consumption. Details of monetary saving are given in Annexure 3.

3.3 Social benefits

3.3.1 Improvement in working environment in the plant

As installation of new individual drive system will remove long belts and long shafts, the working environment will improve due to more safety of the workers, as in earlier case,

there limited space in the mill for the movement and hence working environment may improve.

3.3.2 Improvement in skill set of workers

The technology selected for the implementation is new and energy efficient. The technology implemented will create awareness among the workforce and improves skills of the workers.

3.4 Environmental benefits

3.4.1 Reduction in effluent generation

Not applicable

3.4.2 Reduction in GHG emission such as CO₂, NO_x, etc

The major GHG emission reduction source is CO₂. The technology will reduce grid electricity consumption and emission reductions are estimated at 15 tons of CO₂ per annum due to implementation of the project activity.

3.4.3 Reduction in other emissions like SO_x

No significant impact on SO_x emissions.

4. INSTALLATION OF NEW ENERGY EFFICIENT EQUIPMENT

4.1 Cost of equipment implementation

4.1.1 Cost of equipments

The total cost of Individual Drive Systems is estimated at ` 1.00 lakh as per the quotation provided in Annexure 7.

4.1.2 Other costs

Cost included in Panel, SFU, cabling and commissioning is ` 0.50 lakh. Detail of project cost is furnished in Table 4.1 below:

Table 4.1: Project cost

| S.No | Particular | Unit | Value |
|------|---------------------------------------------------|-----------|-------|
| 1 | Individual motors | ` in lakh | 1.00 |
| 2 | Cabling, Shaft , Modifications, Commissioning etc | ` in lakh | 0.50 |
| 3 | Contingency | ` in lakh | 0.15 |
| 4 | Total Investment | ` in lakh | 1.65 |

4.2 Arrangement of funds

4.2.1 Entrepreneur's contribution

The entrepreneur's contribution is 25% of total project cost, which works out at ` 0.41 lakh.

4.2.2 Loan amount

The term loan is 75% of the total project cost, which is ` 1.24 lakh.

4.2.3 Terms & conditions of loan

The interest rate is considered at 10.0% which is prevailing interest rate of SIDBI for energy efficiency related projects. The loan tenure is 5 years and the moratorium period is 6 months.

4.3 Financial indicators

4.3.1 Cash flow analysis

Considering the above discussed assumptions, the net cash accruals starting with ` 0.37 lakh in the first year operation and increases to ` 1.63 lakh at the end of eighth year.

4.3.2 Simple payback period

The total project cost of the proposed technology is ` 1.65 lakh and monetary savings due to reduction in electricity consumption is ` 0.64 lakh and the simple payback period work out to be 2.58 years.

4.3.3 Net Present Value (NPV)

The Net present value of the investment at 10.0% interest rate works out to be ` 0.65 lakh.

4.3.4 Internal rate of return (IRR)

The after tax Internal Rate of Return of the project works out to be 21.20%. Thus the project is financially viable.

4.3.5 Return on investment (ROI)

The average return on investment of the project activity works out at 24.78%.

4.4 Sensitivity analysis in realistic, pessimistic and optimistic scenarios

A sensitivity analysis has been worked out to ascertain how the project financials would behave in different situations like there is an increase in power savings or decrease. For the purpose of sensitive analysis, two scenarios are considered are.

- Increase in power savings by 5%
- Decrease in power savings by 5%

In each scenario, other inputs are assumed as constant. The financial indicators in each of the above situation are indicated along with standard indicators.

Table 4.2: Sensitivity analysis

| <i>Particulars</i> | <i>IRR %</i> | <i>NPV ` (In lakh)</i> | <i>ROI %</i> | <i>DSCR</i> |
|------------------------------|------------------|----------------------------|------------------|-------------|
| Normal | 21.20% | 0.65 | 24.78 | 1.53 |
| 5% increase in power savings | 23.18% | 0.77 | 25.10 | 1.61 |
| 5% decrease in power savings | 19.18% | 0.52 | 24.41 | 1.45 |

4.5 Procurement and implementation schedule


The project is expected to be completed in 4 weeks from the date of release of purchase order. The detailed schedule of project implementation is furnished in Annexure 5.

Annexure 1: Energy audit and baseline establishment

| <i>Name of the unit</i> | Machine Name | Rated Capacity kW | Voltage Volt | Current Amp | Power factor | Active Power kW | Loading % |
|-------------------------|---------------------|--------------------------|---------------------|--------------------|---------------------|------------------------|------------------|
| Balaji Traders | Main Motor | 37.3 | 303 | 24.34 | 0.89 | 11.40 | 30.56 |

| S. No | Equipment | Capacity of motor (hp) | No of motors | Rated (kW) For each motor | Actual (kW) for each motor | No of (hours) | No of (days) | kWh per annum |
|--------------|-----------------------------------------------|-------------------------------|---------------------|----------------------------------|-----------------------------------|----------------------|---------------------|----------------------|
| 1 | Elevators | 1 | 3 | 0.75 | 0.24 | 10 | 320 | 2304 |
| 2 | Chaluni | 1 | 2 | 0.75 | 0.24 | 10 | 320 | 1536 |
| 3 | Rubber Sheller | 7.5 | 1 | 5.63 | 2.4 | 10 | 320 | 7680 |
| 4 | Cones | 10 | 2 | 7.50 | 3.3 | 10 | 320 | 21120 |
| 5 | Separator | 2 | 1 | 1.50 | 0.7 | 10 | 320 | 2240 |
| 6 | Suggested consumption kWh / annum (1+2+3+4+5) | | | | | | | 34880 |
| 7 | Present consumption kWh/ annum | | | | | | | 50000 |
| 8 | Net saving kWh/annum | | | | | | | 15120 |

Annexure 2: Process flow diagram

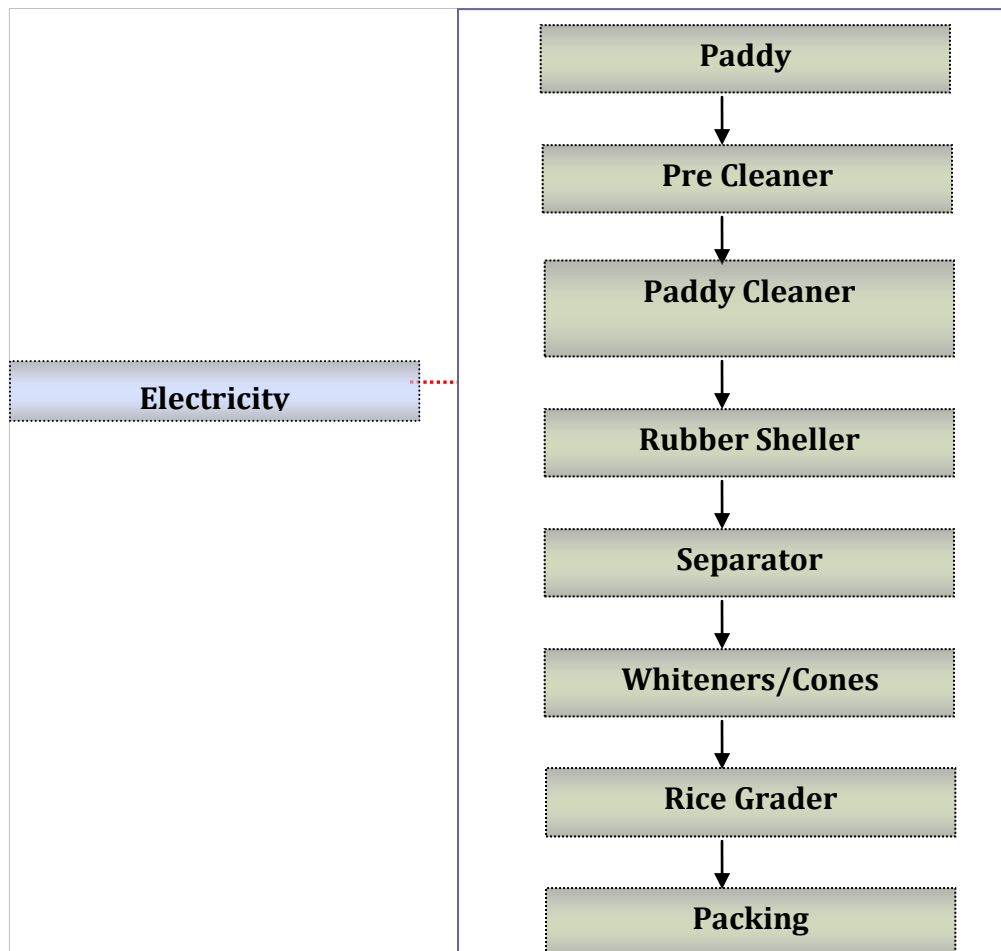

Annexure 3: Detailed Technology Assessment Report

| S.No. | Particulars | Unit | Value |
|--------------|---------------------------------------------------------------------|-------------|--------------|
| 1 | Power consumption in common drives system | kWh | 50000 |
| 2 | Power consumption in individual drives system (As calculated above) | kWh | 34880 |
| 3 | Reduction in power consumption | kWh | 15120 |
| 4 | Cost of electricity | ` /kWh | 4.20 |
| 5 | Monetary benefit | ` (In lakh) | 0.64 |
| 6 | Investment required | ` (In lakh) | 1.65 |
| 7 | Simple payback period | Years | 2.58 |

Annexure 4: Detailed Financial Calculations & Analysis**Assumption**

| Name of the Technology | Individual Drive System | | |
|---------------------------------------|--------------------------------|--------------|----------------------|
| Rated Capacity | 1.5 TPH | | |
| Details | Unit | Value | Basis |
| Installed Capacity | TPH | 1.5 | |
| No of working days | Days | 320 | |
| Operating hour | Hrs | 10 | |
| Proposed Investment | | | |
| Equipment cost | ` (in lakh) | 1.00 | |
| Cabling, Civil works and Modification | ` (in lakh) | 0.50 | |
| Contingency | ` (in lakh) | 0.15 | |
| Total Investment | ` (in lakh) | 1.65 | |
| Financing pattern | | | |
| Own Funds (Equity) | ` (in lakh) | 0.41 | |
| Loan Funds (Term Loan) | ` (in lakh) | 1.24 | |
| Loan Tenure | years | 5 | Assumed |
| Moratorium Period | Months | 6 | Assumed |
| Repayment Period | Months | 66 | Assumed |
| Interest Rate | %age | 10.00% | SIDBI Lending rate |
| Estimation of Costs | | | |
| O & M Costs | % on Plant & Equip | 4.00 | Feasibility Study |
| Annual Escalation | %age | 5.00 | Feasibility Study |
| Estimation of Revenue | | | |
| Electricity saving | kWh/annum | 15120 | |
| Cost | `/kWh | 4.2 | |
| St. line Depn. | %age | 5.28 | Indian Companies Act |
| IT Depreciation | %age | 80.00 | Income Tax Rules |
| Income Tax | %age | 33.99 | Income Tax |

Estimation of Interest on Term Loan

| Years | Opening Balance | Repayment | Closing Balance | Interest |
|--------------|------------------------|------------------|------------------------|-----------------|
| 1 | 1.24 | 0.06 | 1.18 | 0.14 |
| 2 | 1.18 | 0.12 | 1.06 | 0.11 |
| 3 | 1.06 | 0.24 | 0.82 | 0.09 |
| 4 | 0.82 | 0.32 | 0.50 | 0.07 |
| 5 | 0.50 | 0.36 | 0.14 | 0.04 |
| 6 | 0.14 | 0.14 | 0.00 | 0.00 |
| | | 1.24 | | |

WDV Depreciation

₹ (in lakh)

| Particulars / years | 1 | 2 |
|----------------------------|------|------|
| Plant and Machinery | | |
| Cost | 1.65 | 0.33 |
| Depreciation | 1.32 | 0.26 |
| WDV | 0.33 | 0.07 |

Projected Profitability

₹ (in lakh)

| Particulars / Years | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
|------------------------|------|------|------|------|------|------|------|------|
| Fuel savings | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 |
| Total Revenue (A) | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 |
| Expenses | | | | | | | | |
| O & M Expenses | 0.07 | 0.07 | 0.07 | 0.08 | 0.08 | 0.08 | 0.09 | 0.09 |
| Total Expenses (B) | 0.07 | 0.07 | 0.07 | 0.08 | 0.08 | 0.08 | 0.09 | 0.09 |
| PBDIT (A)-(B) | 0.57 | 0.57 | 0.56 | 0.56 | 0.55 | 0.55 | 0.55 | 0.54 |
| Interest | 0.14 | 0.11 | 0.09 | 0.07 | 0.04 | - | - | - |
| PBDT | 0.43 | 0.45 | 0.47 | 0.49 | 0.52 | 0.55 | 0.55 | 0.54 |
| Depreciation | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 |
| PBT | 0.34 | 0.37 | 0.38 | 0.40 | 0.43 | 0.46 | 0.46 | 0.46 |
| Income tax | - | 0.06 | 0.16 | 0.17 | 0.18 | 0.19 | 0.19 | 0.18 |
| Profit after tax (PAT) | 0.34 | 0.30 | 0.22 | 0.24 | 0.26 | 0.28 | 0.27 | 0.27 |

Computation of Tax

₹ (in lakh)

| Particulars / Years | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
|------------------------|--------|------|------|------|------|------|------|------|
| Profit before tax | 0.34 | 0.37 | 0.38 | 0.40 | 0.43 | 0.46 | 0.46 | 0.46 |
| Add: Book depreciation | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 |
| Less: WDV depreciation | 1.32 | 0.26 | - | - | - | - | - | - |
| Taxable profit | (0.89) | 0.19 | 0.47 | 0.49 | 0.52 | 0.55 | 0.55 | 0.54 |
| Income Tax | - | 0.06 | 0.16 | 0.17 | 0.18 | 0.19 | 0.19 | 0.18 |

Projected Balance Sheet

₹ (in lakh)

| Particulars / Years | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
|--------------------------------------|------|------|------|------|------|------|------|------|
| Liabilities | | | | | | | | |
| Share Capital (D) | 0.41 | 0.41 | 0.41 | 0.41 | 0.41 | 0.41 | 0.41 | 0.41 |
| Reserves & Surplus (E) | 0.34 | 0.64 | 0.86 | 1.10 | 1.35 | 1.63 | 1.90 | 2.17 |
| Term Loans (F) | 1.18 | 1.06 | 0.82 | 0.50 | 0.14 | 0.00 | 0.00 | 0.00 |
| Total Liabilities (D)+(E)+(F) | 1.93 | 2.11 | 2.09 | 2.01 | 1.90 | 2.04 | 2.31 | 2.58 |

| Assets | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
|-------------------------|------|------|------|------|------|-------|-------|-------|
| Gross Fixed Assets | 1.65 | 1.65 | 1.65 | 1.65 | 1.65 | 1.65 | 1.65 | 1.65 |
| Less Accm. Depreciation | 0.09 | 0.17 | 0.26 | 0.35 | 0.44 | 0.52 | 0.61 | 0.70 |
| Net Fixed Assets | 1.56 | 1.48 | 1.39 | 1.30 | 1.21 | 1.13 | 1.04 | 0.95 |
| Cash & Bank Balance | 0.37 | 0.63 | 0.70 | 0.71 | 0.69 | 0.91 | 1.27 | 1.63 |
| TOTAL ASSETS | 1.93 | 2.11 | 2.09 | 2.01 | 1.90 | 2.04 | 2.31 | 2.58 |
| Net Worth | 0.75 | 1.05 | 1.27 | 1.51 | 1.76 | 2.04 | 2.32 | 2.59 |
| Debt Equity Ratio | 2.85 | 2.56 | 1.98 | 1.21 | 0.33 | -0.01 | -0.01 | -0.01 |

Projected Cash Flow

` (in lakh)

| Particulars / Years | 0 | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
|----------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Sources | | | | | | | | | |
| Share Capital | 0.41 | - | - | - | - | - | - | - | - |
| Term Loan | 1.24 | | | | | | | | |
| Profit After tax | | 0.34 | 0.30 | 0.22 | 0.24 | 0.26 | 0.28 | 0.27 | 0.27 |
| Depreciation | | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 |
| Total Sources | 1.65 | 0.43 | 0.39 | 0.31 | 0.32 | 0.34 | 0.36 | 0.36 | 0.36 |
| Application | | | | | | | | | |
| Capital Expenditure | 1.65 | | | | | | | | |
| Repayment Of Loan | - | 0.06 | 0.12 | 0.24 | 0.32 | 0.36 | 0.14 | - | - |
| Total Application | 1.65 | 0.06 | 0.12 | 0.24 | 0.32 | 0.36 | 0.14 | - | - |
| Net Surplus | - | 0.37 | 0.27 | 0.07 | 0.00 | (0.02) | 0.22 | 0.36 | 0.36 |
| Add: Opening Balance | - | - | 0.37 | 0.63 | 0.70 | 0.71 | 0.69 | 0.91 | 1.27 |
| Closing Balance | - | 0.37 | 0.63 | 0.70 | 0.71 | 0.69 | 0.91 | 1.27 | 1.63 |

IRR

` (in lakh)

| Particulars / months | 0 | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
|-----------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Profit after Tax | | 0.34 | 0.30 | 0.22 | 0.24 | 0.26 | 0.28 | 0.27 | 0.27 |
| Depreciation | | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 |
| Interest on Term Loan | | 0.14 | 0.11 | 0.09 | 0.07 | 0.04 | - | - | - |
| Cash outflow | (1.65) | - | - | - | - | - | - | - | - |
| Net Cash flow | (1.65) | 0.57 | 0.50 | 0.40 | 0.39 | 0.38 | 0.36 | 0.36 | 0.36 |
| IRR | 21.20% | | | | | | | | |

| | |
|-----|------|
| NPV | 0.65 |
|-----|------|

Break Even Point

` (in lakh)

| Particulars / Years | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
|----------------------------|----------|----------|----------|----------|----------|----------|----------|----------|
| Variable Expenses | | | | | | | | |
| Oper. & Maintenance Exp | 0.05 | 0.05 | 0.05 | 0.06 | 0.06 | 0.06 | 0.07 | 0.07 |
| Sub Total (G) | 0.05 | 0.05 | 0.05 | 0.06 | 0.06 | 0.06 | 0.07 | 0.07 |
| Fixed Expenses | | | | | | | | |
| Oper. & Maintenance Exp | 0.02 | 0.02 | 0.02 | 0.02 | 0.02 | 0.02 | 0.02 | 0.02 |
| Interest on Term Loan | 0.14 | 0.11 | 0.09 | 0.07 | 0.04 | 0.00 | 0.00 | 0.00 |
| Depreciation (H) | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 |
| Sub Total (I) | 0.25 | 0.22 | 0.20 | 0.18 | 0.14 | 0.11 | 0.11 | 0.11 |
| Sales (J) | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 | 0.64 |
| Contribution (K) | 0.59 | 0.58 | 0.58 | 0.58 | 0.57 | 0.57 | 0.57 | 0.57 |
| Break Even Point (L = G/I) | 42.21% | 37.17% | 34.48% | 30.48% | 24.98% | 18.92% | 19.21% | 19.52% |
| Cash Break Even {(I)-(H)} | 27.33% | 22.23% | 19.47% | 15.40% | 9.82% | 3.68% | 3.89% | 4.11% |
| Break Even Sales (J)*(L) | 0.27 | 0.24 | 0.22 | 0.19 | 0.16 | 0.12 | 0.12 | 0.12 |

Return on Investment

₹ (in lakh)

| Particulars / Years | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | Total |
|----------------------------|----------|----------|----------|----------|----------|----------|----------|----------|--------------|
| Net Profit Before Taxes | 0.34 | 0.37 | 0.38 | 0.40 | 0.43 | 0.46 | 0.46 | 0.46 | 3.30 |
| Net Worth | 0.75 | 1.05 | 1.27 | 1.51 | 1.76 | 2.04 | 2.32 | 2.59 | 13.29 |
| | | | | | | | | | 24.78% |

Debt Service Coverage Ratio

₹ (in lakh)

| Particulars / Years | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | Total |
|----------------------------|----------|----------|----------|----------|----------|----------|----------|----------|--------------|
| Cash Inflow | | | | | | | | | |
| Profit after Tax | 0.34 | 0.30 | 0.22 | 0.24 | 0.26 | 0.28 | 0.27 | 0.27 | 1.63 |
| Depreciation | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.09 | 0.52 |
| Interest on Term Loan | 0.14 | 0.11 | 0.09 | 0.07 | 0.04 | 0.00 | 0.00 | 0.00 | 0.46 |
| Total (M) | 0.57 | 0.50 | 0.40 | 0.39 | 0.38 | 0.36 | 0.36 | 0.36 | 2.61 |

DEBT

| | | | | | | | | | |
|------------------------|------|------|------|------|------|------|------|------|------|
| Interest on Term Loan | 0.14 | 0.11 | 0.09 | 0.07 | 0.04 | 0.00 | 0.00 | 0.00 | 0.46 |
| Repayment of Term Loan | 0.06 | 0.12 | 0.24 | 0.32 | 0.36 | 0.14 | 0.00 | 0.00 | 1.24 |
| Total (N) | 0.20 | 0.23 | 0.33 | 0.39 | 0.40 | 0.14 | 0.00 | 0.00 | 1.70 |
| | 0.14 | 0.11 | 0.09 | 0.07 | 0.04 | 0.00 | 0.00 | 0.00 | 0.46 |
| Average DSCR (M/N) | 1.53 | | | | | | | | |

Annexure 5: Details of procurement and Implementation plan**Project Implementation Schedule**

| S. No | Activity | Weeks | | | |
|-------|---------------------------------------------------|-------|---|----|-----|
| | | 1 | 2 | 3/ | 5/6 |
| 1 | Placement of Orders for motors and panels | | | | |
| 2 | Supply of motors and panels | | | | |
| 3 | Installation of the motors and panels and cabling | | | | |
| 4 | Trial runs | | | | |

Process Down Time

| S. No | Activity | Weeks | | | |
|-------|---------------------------------------------------|-------|---|-----|-----|
| | | 1 | 2 | 3/4 | 5/6 |
| 1 | Dismantling of the existing common drive system | | | | |
| 2 | Supply of motors and panels | | | | |
| 3 | Installation of the motors and panels and cabling | | | | |
| 4 | Trial runs | | | | |

The process down time is considered for one week.


Annexure 6: Details of technology/equipment and service providers

| Equipment details | Source of technology | Service/technology providers |
|--------------------------|-----------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Individuals Drives | Indigenous | R.K Associates Padhuanpada, Proof Road, Balasore, Orissa-756001,India. Mobile/CellPhone: +(91)- 9438286089/9337749353 |
| Individuals Drives | Indigenous | Suri Engineering Works 4/4, IDA, Nacharam, Hyderabad, Andhra Pradesh, India. Contact number:040-27150282/27177726 Contact person: K.Rameshwar Reddy |
| Individuals Drives | Indigenous | Rice-tec Machinery 57/p, phase-1, IDA, Jeedimetla, Hyderabad, Andhra Pradesh, India. Contactnumber:040-23195938, 9440624435/9246373477 Contact person: Bhanu Prakash |
| Individuals Drives | Indigenous | Baba Auto Mechanical Works c-12/b, IDA, Hyderabad, Andhra Pradesh, India. Contact number:040-27207565/9985455770 Contact person: Ravi Shankar |

Annexure 7: Quotations or Techno-Commercial Bids

QUOTATION

Ph : (O) 66568120
 Telefax : 66338262
 Mobile : 9849006201



SLR ENTERPRISES

AUTHORISED DEALER FOR :
FINOLEX CABLES LTD, ROTOMOTIVE - MOTORS & WORM GEAR BOXES
 D. No. 3464, (4-3-1 to 6) 3rd Floor, "Dundoo Vihar", R.P. Road, Secunderabad - 500 003.

Qtn. No. : 358 Date: 24/12/10.

Ref. No. :

| S.No. | DESCRIPTION | Qty. | Unit Price | Amount Rs. Ps. |
|-------|---------------------------------------------------|------|------------|------------------------|
| 4) | SIEMENS Make 1500 RPM FOOT MOUNTING MOTOR EFF1 | | | |
| 1) | 5 HP 1SED 113-4YB80 | | 19935/- | |
| 2) | 7.5 HP 1SED 130-4YB80 | | 27470/- | |
| 3) | 10 HP 1SED 133-4YB80 | | 31995/- | |
| 4) | 12.5 HP 1SED 163-4YB80 | | 51480/- | |
| 5) | 15 HP 1SED 163-4YB80 | | 52900/- | |
| 6) | 20 HP 1SED 166-4YB80 | | 65750/- | |
| 7) | 25 HP 1SED 183-4YB80 | | 86830/- | |
| 8) | 30 HP 1SED 186-4YB80 | | 91680/- | |
| 9) | 40 HP 1SED 208-4YB80 | | 123750/- | |
| 10) | 50 HP 1SED 221-4YB80 | | 160500/- | |

Discount: 45% extra @ 10.3%

APGST No. SEC/10/1/2734/98-97 CST No. : SEC/10/1/2952/2000-2001
 Valid from : 1-4-1998 w.e.f. : 1-8-2000

Terms & Conditions :


1) Prices : Vast @ 4% extra for SL no 1703 & 14.5% extra for client for **SLR ENTERPRISES**

2) Delivery : Ex-Stock

3) F.O.R. : Sec Nagar

4) Payment : 25% advance balance against delivery

5) Validity : One week

| QUOTATION | | | | |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------|------|----------------------------------------------------------------|-------------------|
|  | | | Ph : (O) 66568120 Telefax : 66338262 Mobile : 9849006201 | |
| AUTHORISED DEALER FOR : FINOLEX CABLES LTD, ROTOMOTIVE - MOTORS & WORM GEAR BOXES D. No. 3464, (4-3-1 to 6) 3rd Floor, "Dundoo Vihar", R.P. Road, Secunderabad - 500 003. | | | | |
| | | | Qtn. No. : | 359 |
| | | | Date : | 24/12/10 |
| | | | Ref. No. : | |
| S.No. | DESCRIPTION | Qty. | Unit Price | Amount Rs. Ps. |
| 1 | STEEL MOUNTING MOTOR 1500 RPM | | | |
| 2 | 60 HP 1SED 223-4YLSO | | 198,400/- | |
| 3 | 75 HP 1SED 254-4YASO | | 252,500/- | |
| 4 | 100 HP 1SED 281-4YASO | | 323,150/- | |
| 5 | 120 HP 1SED 284-4YASO | | 374,910/- | |
| 6 | 150 HP 1SED 311-4YASO | | 453,900/- | |
| LESS DISCOUNT : 4.5% | | | | |
| EXCISE DUTY : 10.3% | | | | |
| TIN : 28630156311 APGST No. SEC/10/1/2734/98-97 Valid from : 1-4-1996 CST No. : SEC/10/1/2352/2000-2001 w.e.f. : 1-8-2000 | | | | |
| Terms & Conditions : 1) Prices : 14.5% extra 2) Delivery : Co. Office 3) F.O.R. : Sec. Road 4) Payment : 25% advance balance against delivery. 5) Validity : One month. | | | | |
| | | | for SLR ENTERPRISES | |



Bureau of Energy Efficiency (BEE)

(Ministry of Power, Government of India)

4th Floor, Sewa Bhawan, R. K. Puram, New Delhi – 110066

Ph.: +91 – 11 – 26179699 (5 Lines), Fax: +91 – 11 – 26178352

Websites: www.bee-india.nic.in, www.energymanagertraining.com



Zenith Energy Services Pvt. Ltd

10-5-6/B, My Home Plaza, Masab

Tank HYDERABAD, AP 500 028

Phone: 040 23376630, 31,

Fax No.040 23322517

Website: www.zenithenergy.com



India SME Technology Services Ltd

DFC Building, Plot No.37-38,

D-Block, Pankha Road,

Institutional Area, Janakpuri, New Delhi-110058

Tel: +91-11-28525534, Fax: +91-11-28525535

Website: www.techsmall.com